

ELGA

PURELAB® Chorus

Solutions For Type II Pure Water
And Type III General Grade Water



Distribuito da:
Zetalab s.r.l.

Zetalab

Via Castelfidardo, 11 - 35141 Padova
Telefono 049 2021144 - Fax 049 2021143
Internet: www.zetalab.it - e-mail: info@zetalab.it

 **VEOLIA**
WATER

Solutions & Technologies

Configure your solution

Step 1: Choose your system

Typical Applications	Select The Impurities You Want To Remove	Integrated Purification Technology			Your Daily Water Requirements	Your System and Part Number
		Pre-treatment (Carbon & Filtration)	Reverse Osmosis (RO Cartridge)	Ion-exchange (Purification Pack)		
Stills Replacement Buffer Preparation pH Solution Preparation Washing/Rinsing All Stainless Steel Autoclaves General Chemistry Spectrophotometry Feed to Type I & II Polisher	Inorganics (e.g. Calcium, Magnesium, Sodium, Bicarbonate, Sulphate)	✓	✓	✓	Up to 480 l/day (127 USG/day) Equivalent to 20 l/hour	PURELAB Chorus 2 (RO/DI)
	Organics (e.g. Pesticides, Herbicides, Decayed Plant & Animal Tissues)					
	Particulates (>99% Removal of Anything ≥0.2µm)					
	Bacteria (<5 CFU/ml)					Part No. PC2RODIM1*
Glassware Rinsing, Heating Baths Autoclave Filling Hydroponics / Plant Growth Cabinets Steam Generators, Stability Chambers Sterilizer Feed Feed to Type I & II Polishers	Inorganics (e.g. Calcium, Magnesium, Sodium, Bicarbonate, Sulphate)	✓	✓	●	Up to 240 l/day (63 USG/day) Equivalent to 10 l/hour	PURELAB Chorus 3 (RO)
	Organics (e.g. Pesticides, Herbicides, Decayed Plant & Animal Tissues)					
	Particulates (>99% Removal of Anything ≥0.2µm)				Up to 480 l/day (127 USG/day) Equivalent to 20 l/hour	Part No. RO310XXM1 or RO310BPM1*
						
					Up to 720 l/day (190 USG/day) Equivalent to 30 l/hour	Part No. RO320XXM1 or RO320BPM1*
	Bacteria (<5 CFU/ml)					
					Part No. RO330XXM1 or RO330BPM1*	

Up to four x PURELAB Chorus 2 systems can be configured for a product flow rate of 80 l/hr

Up to four x PURELAB Chorus 3 systems can be configured for a product flow rate of 120 l/hr

*Fitted with integral potable feed water boost pump

Step 2: Optimize Step 3: Choose your water storage options

Optimize your Running Costs	Features							Working Volume and Part Number
	Configured Remotely to PURELAB Chorus	Configured on Top of PURELAB Chorus	Configured Underneath PURELAB Chorus	Wall mounting	Floor mounting	Dispense tap (1 supplied, 2nd tap optional)	15mm OD connection Max outlet flow 7 l/min (2 USG)	
Degassing Module Part No. LA775 CO ₂ removal from the pre-purified water (post RO) increases the life of downstream consumables fitted to PURELAB Chorus 1 or 2 Recommended when the CO ₂ present in the feed water is ≥ the conductivity of the pre-purified water (post RO)	✓	✓	✓	✓ Part No. LA770	✓	✓ Part No. TAPS 39993	✓	15 liter (4 USG)  Part No. LA757
Technology Note TN034	✓	✓	✓	✓ Part No. LA770	✓	✓ Part No. TAPS 39993	✓	30 liter (8 USG)  Part No. LA758
High Recovery Kit Part No. LA765 Recommended in areas where water hardness <25ppm, feeding directly to your application.	✓	•	✓	✓ Part No. LA771	✓	✓ Part No. TAPS 39993	✓	60 liter (16 USG)  Part No. LA759
Technology Note TN035								

To download Technology Notes, please visit www.elgalabwater.com

Step 4: Choose the configuration that suits your laboratory



Wall Mounted



PURELAB Chorus 2 or 3

Configured next to storage reservoir



PURELAB Chorus 2 or 3

With 15 or 30 liter reservoir
configured on top
(floor, bench or wall mounted)



PURELAB Chorus 2 or 3

With 60 liter reservoir
configured underneath
(floor, bench or wall mounted)




2 x PURELAB Chorus 3


Configured together
(floor, bench or wall mounted)

What's inside?

PURELAB® Chorus 2 (RO/DI) – Pure Water for General Laboratory Applications

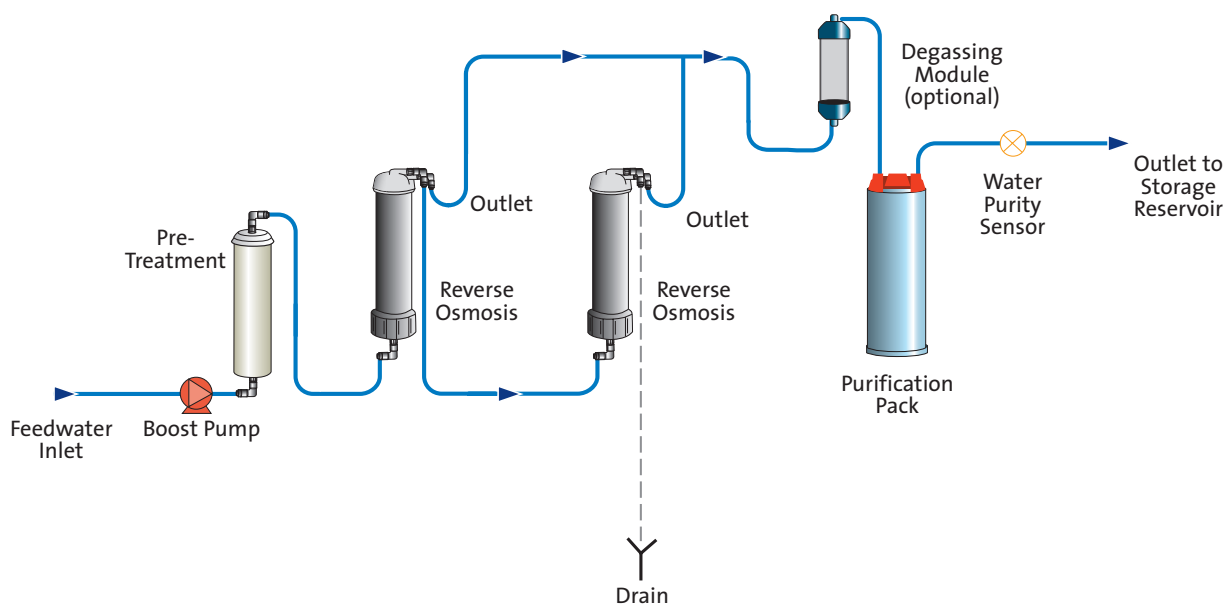

PURELAB® Chorus 3 (RO) – General Grade Water for Laboratory Applications

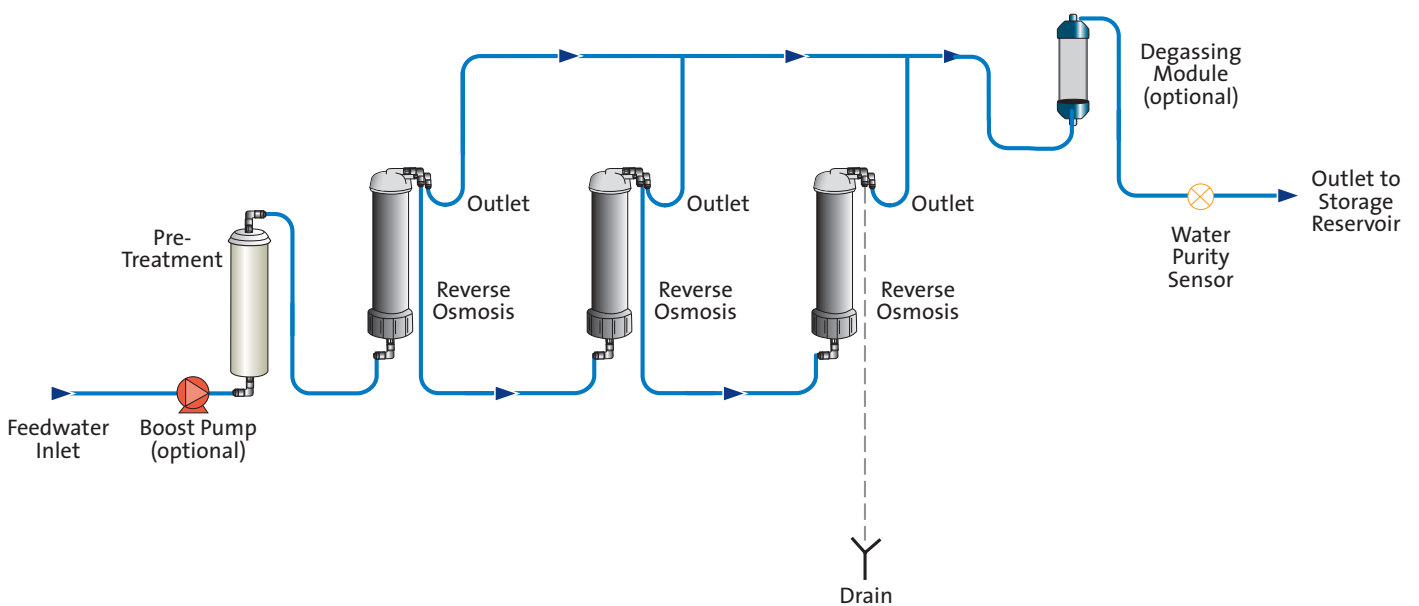

Treated Water Specifications

MODEL	PURELAB Chorus 2 (RO/DI)		PURELAB Chorus 3 (RO)	
Nominal output (max)	20 l/hr	10 l/hr	20 l/hr	30 l/hr
Nominal daily output (max)	480 l/24 hour day ¹	240 l/24 hour day ¹	480 l/24 hour day ¹	720 l/24 hour day ¹
Inorganics @ 25°C	1 to >10 MΩ-cm		>95% rejection	
Organics (MW>200 Dalton)	>99% rejection		>99% rejection	
Total organic carbon (TOC)	<30 ppb ²		<50 ppb ²	
Bacteria	<5 CFU/ml ²		<5 CFU/ml ²	
pH	Effectively neutral		Effectively neutral	
Particles	>99% rejection		>99% rejection	
Purification pack capacity	Liters to 1MΩ-cm = 90,000/(μS/cm + (2.3 x ppm CO ₂))		–	

¹ Standard conditions are 4 bar inlet pressure at 15 degrees centigrade, fed with potable water and a clean pre-treatment cartridge.
Refer to flow tables outside these conditions. ² Subject to correct operating and maintenance procedures

Dimensions and Weights

Dimensions	Height minimum 435mm, Width 375mm, Depth 340mm			
Weight with internal boost pump	20kg (44lb)	17kg (37lb)	18kg (40lb)	19kg (42lb)
Weight without internal boost pump		15kg (33lb)	16kg (35lb)	17kg (37lb)

Feedwater Requirement

Source – originally from potable supply, then pre-treated	Potable mains water supply	
Fouling index (max)	10	
Conductivity	<2000 µS/cm ³	
Free Chlorine (max)	0.5 ppm	
Heavy Metals (max)	0.05 ppm	
Silica	30 ppm	
Temperature	1 - 35°C	
Flowrate (maximum requirement)	100 l/hr (27 USG)	100 l/hr (27 USG)
Drain requirements (gravity fall with air gap). Maximum during service	80 l/hr (21 USG)	80 l/hr (21 USG)
Feedwater pressure		
Maximum – with internal boost pump	2.0 bar (30 psi) ⁴	
Minimum – with internal boost pump	0.5 bar (7.5 psi)	
Maximum – without internal boost pump	–	6.0 bar (90 psi) ⁴
Minimum – without internal boost pump	–	4.0 bar (60 psi)

³ Deionization cartridge life may vary with feedwaters >1400 μS/cm ⁴ Fit LA652 Regulator where feedwater pressure exceeds specified limits.

Electrical Requirements

Mains Input	100 - 240V AC, 50 - 60Hz all models
System voltage	24V DC
Power consumption during peak demand	60VA
Noise level	<45 dBA

Reservoir Dimensions

LA757 - 15ltr Storage Reservoir	Height 470mm, Width 376mm, Depth 340mm
LA758 - 30ltr Storage Reservoir	Height 660mm, Width 376mm, Depth 340mm
LA759 - 60ltr Storage Reservoir	Height 570mm, Width 532mm, Depth 522mm

ELGA LabWater
Tel: +44 (0) 1494 887500 Fax: +44 (0) 1494 887505
Email: info@elgalabwater.com Website: www.elgalabwater.com

Distribuito da:
Zetalab s.r.l.



Via Castelfidardo, 11 - 35141 Padova
Telefono 049 2021144 - Fax 049 2021143
Internet: www.zetalab.it - e-mail: info@zetalab.it

ELGA is the global laboratory water brand name of Veolia Water Solutions and Technologies. The information contained in this document is the property of VWS (UK) Ltd, trading as ELGA LabWater, and is supplied without liability for errors or omissions.
© VWS (UK) Ltd. 2013 – All rights reserved. ELGA® and PURELAB® are registered trademarks of VWS (UK) Ltd.

LITR40039-03